


STANDARD DETAILS/WATER/WAT-04

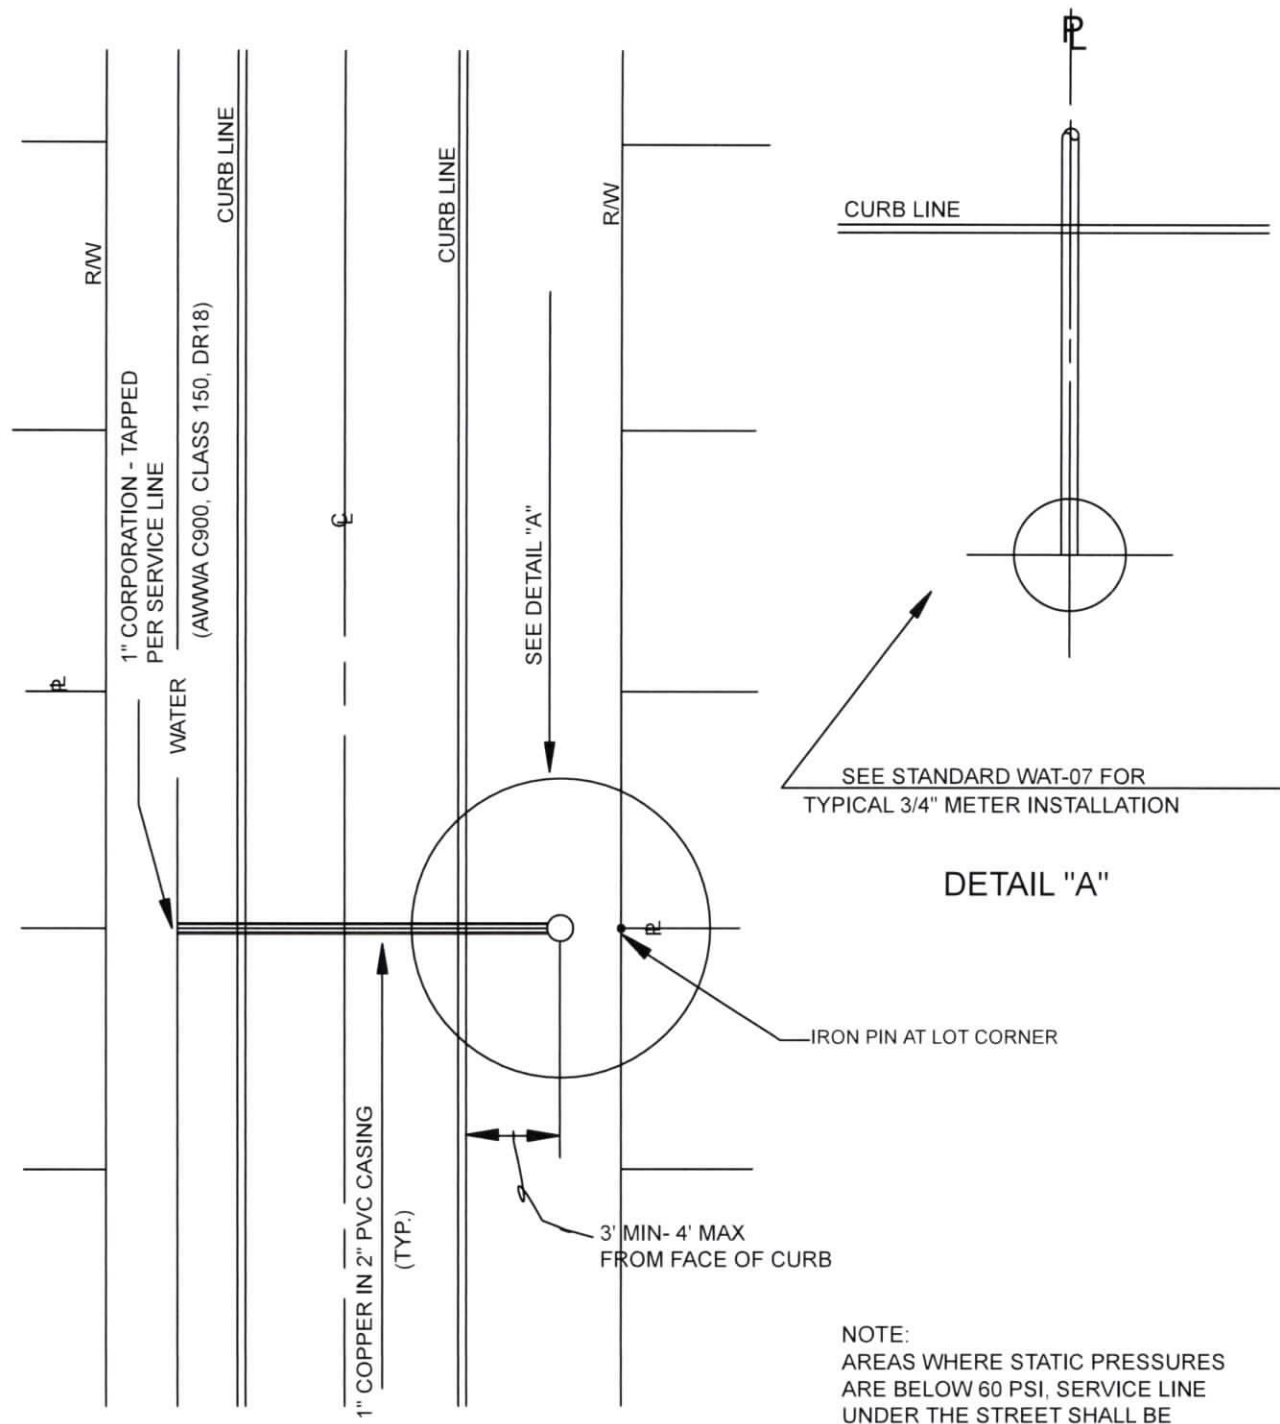

SEE STANDARD WAT-07 FOR
TYPICAL 3/4" METER INSTALLATION

DETAIL "A"

NOTE:
AREAS WHERE STATIC PRESSURES
ARE BELOW 60 PSI, SERVICE LINE
UNDER THE STREET SHALL BE
1 1/4" DIAMETER.

NOTE:
ODOT TYPE "A"
AGGREGATE FROM
TOP OF PIPE TO
BASE

REVISION	BY	DATE	LONG WATER SERVICE (SINGLE)	
			STANDARD DETAILS	
			CITY OF COLLINSVILLE, OKLAHOMA	
			ENGINEERING DIVISION	
			DATE	STANDARD NO.
			02/2020	WAT-04