


NOTES:

1. SLIDING TRENCH SUPPORTS SHALL NOT BE PLACED BELOW THE TOP OF PIPE.
2. WATER TABLE CRADLE SHALL BE INSTALLED FOR THE FULL WITH OF THE TRENCH EXCAVATION.
3. FOR RIGID PIPES USE THE STD. TRENCH WIDTH. SEE TABLE FOR FLEXIBLE PIPES

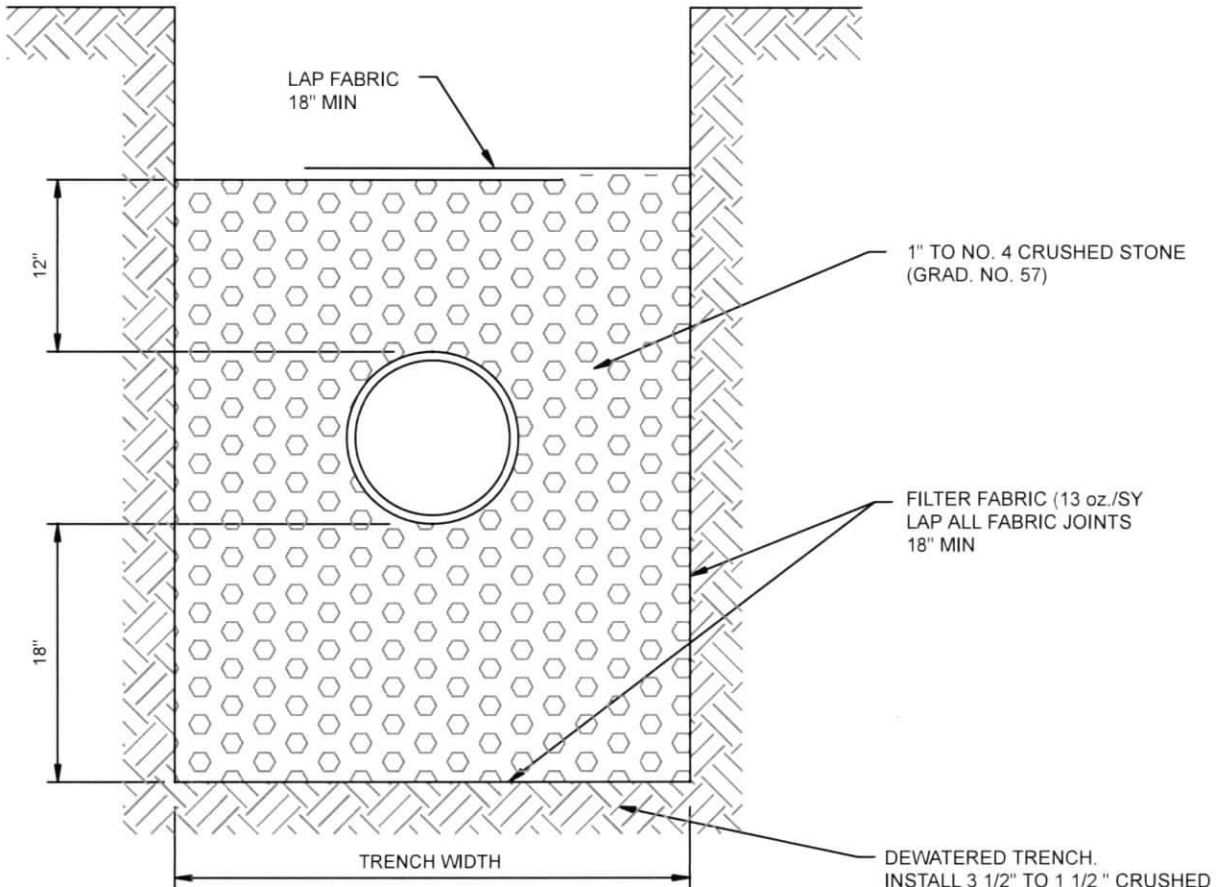

MINIMUM TRENCH WIDTH FOR FLEXIBLE PIPES	
PIPE I.D.	MIN. TRENCH WIDTH
8" - 12"	3' - 0"
14" - 18"	4' - 6"
20" - 24"	6' - 0"
26" - 30"	7' - 6"
32" - 36"	9' - 0"

NOTE:
 FLEXIBLE PIPES ARE PE. ASTM F894 AND PVC. ASTM D3034 & ASTM F679 & ASTM F794
 FOR ALL OTHER PIPES USE THE STANDARD TRENCH WIDTH.

I:\STANDARD DETAILS\SEWER\SAN-08.dwg

REVISION	BY	DATE	WATER TABLE CRADLE FOR FLEXIBLE PIPE STANDARD DETAILS	
			CITY OF COLLINSVILLE, OK	
			ENGINEERING DIVISION	
			DATE: 02/2020	STANDARD NO. SAN-08