


PLAN

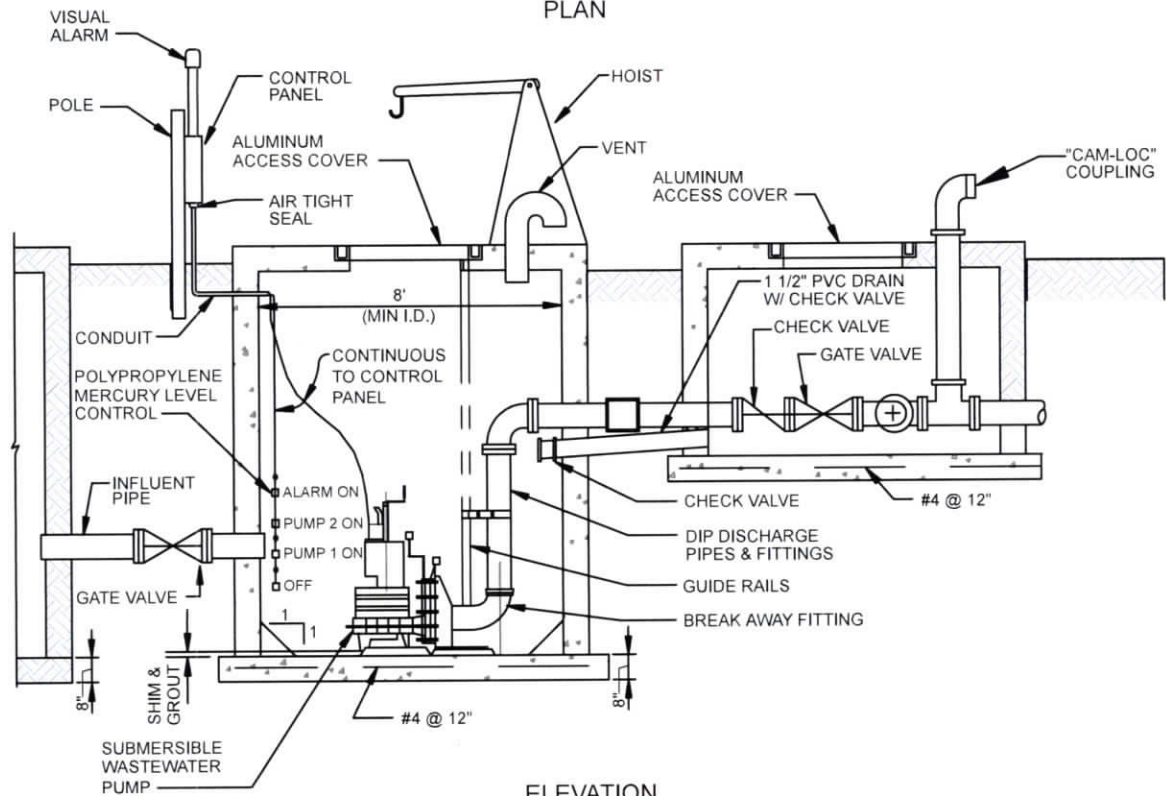

ELEVATION

NOTES:

1. PROVIDE A LADDER AT TOP OF DRYWELL FOR ACCESS TO THE VALVES. (FOR DEPTH OF 4 FEET OR GREATER)
2. A REMOTE SENSING/REPORTING SYSTEM COMPATIBLE WITH SCADA NETWORK.
3. PROVIDE STAINLESS STEEL CHAINS, PUMPRAILS AND BRACKETS.
4. PROVIDE A TWO-TON HOIST ASSEMBLY FOR PUMP REMOVAL.
5. INSTALL AN 8-FOOT CHAIN LINK FENCE WITH SECURITY WIRES AND A TEN-FOOT-WIDE, TWO LEAF GATE.

REVISION	BY	DATE	LIFT STATION STANDARD DETAILS	
			CITY OF COLLINSVILLE, OK.	
			ENGINEERING DIVISION	
			DATE: 02/2020	STANDARD NO. SAN-11

I:\STANDARD DETAILS\SEWER\SAN-11.dwg